

## Impact sound reduction according to ISO 140-8

Measurement of the impact sound reduction through a ceiling pad on a solid reference ceiling in test stands

On behalf of: **EGETÆPPER A/S, INDUSTRIVEJ NORD 25, DK-7400 HERNING**

### Object:

Epoca Silky ECT350

### Assembly:

Design: 083723048  
Batchno.: H007920001-1  
Dyelot: 3928  
Dim.: 3846/2884/16.5mm




Volume of the receiving room: 53,3 m<sup>3</sup>  
Test stand: HfT Stuttgart  
Day of measurement: 30.06.2021

Temperature: 24,9 °C  
Humidity: 42,3 %  
Air pressure: 958 hPa

Frequency f [Hz]	L <sub>n,0</sub> Third [dB]	ΔL Third [dB]
50	65,2	5,5
63	56,4	2,4
80	56,8	2,7
100	62,8	6,5
125	69,1	11,7
160	70,3	10,8
200	69,1	11,2
250	68,5	16,9
315	69,6	22,5
400	69,8	28,1
500	70,7	32,6
630	71,1	39,6
800	71,9	44,9
1000	72,8	50,4
1250	74,8	53,1
1600	75,6	56,4
2000	74,4	62,3
2500	73,0	<65,2
3150	73,3	<67,6
4000	72,2	<67,9
5000	69,9	<65,2

Measurement limit

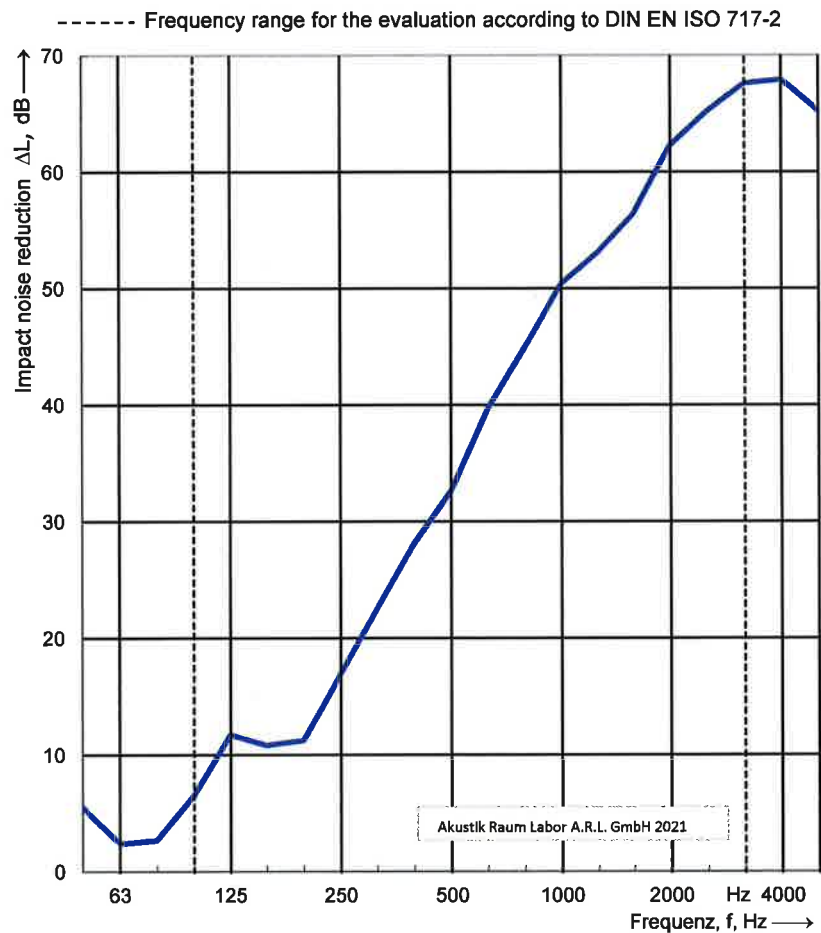

Parameters according DIN EN ISO 717-2:

$\Delta L_w = 29$  dB

$C_{i,\Delta} = -11$  dB

$C_{i,r} = 0$  dB

The measurement results are based on tests carried out with an artificial sound source.

Measurements in third octave band width.

**Akustik Raum Labor**

Report-No.: ARL202106250

Test-No.: T1044

Wächtersbach,

20.09.2021

Signature:

**Akustik Raum Labor A.R.L. GmbH**  
Industriestr. 38  
63607 Wächtersbach

☎ + 49 (0) 6053 62067 0

☎ + 49 (0) 6053 62067 26

✉ info@akustik-raum-labor.de